

MOHANA Renewcare



1#Battery cabinet



2#Battery cabinet



Converging cabinet


250 KW/522 KWh BESS Product Specifications

Project Supply Scope

No	Items	Specifications	Qty	Unit	Remark
1	Battery cabinets	125 KW/261 KWh	2	No.	Each Battery Container consists of 1.1 ~ 1.4
1.1	Li-ion Battery System	261 KWh, 1P52S*5 , LFP	1	No.	Includes 5*1P52S modules, (BMU), Cluster Control Box (includes BC)
1.2	Liquid-cooled System	Liquid-cooled units with a refrigerating capacity of 5kW	1	No.	
1.3	Fire Suppression System (FSS)	Includes smoke sensors, temperature sensors, combustible gas detectors, sound and light alarm system, and back up water-based suppression system	1	No.	
1.4	PCS	Rated power 125 KW for per pcs	1	No.	
2	Converging cabinet	Convergence function, communication function	1	No.	

Station Topology

The field station topology of the whole system is shown in figure:

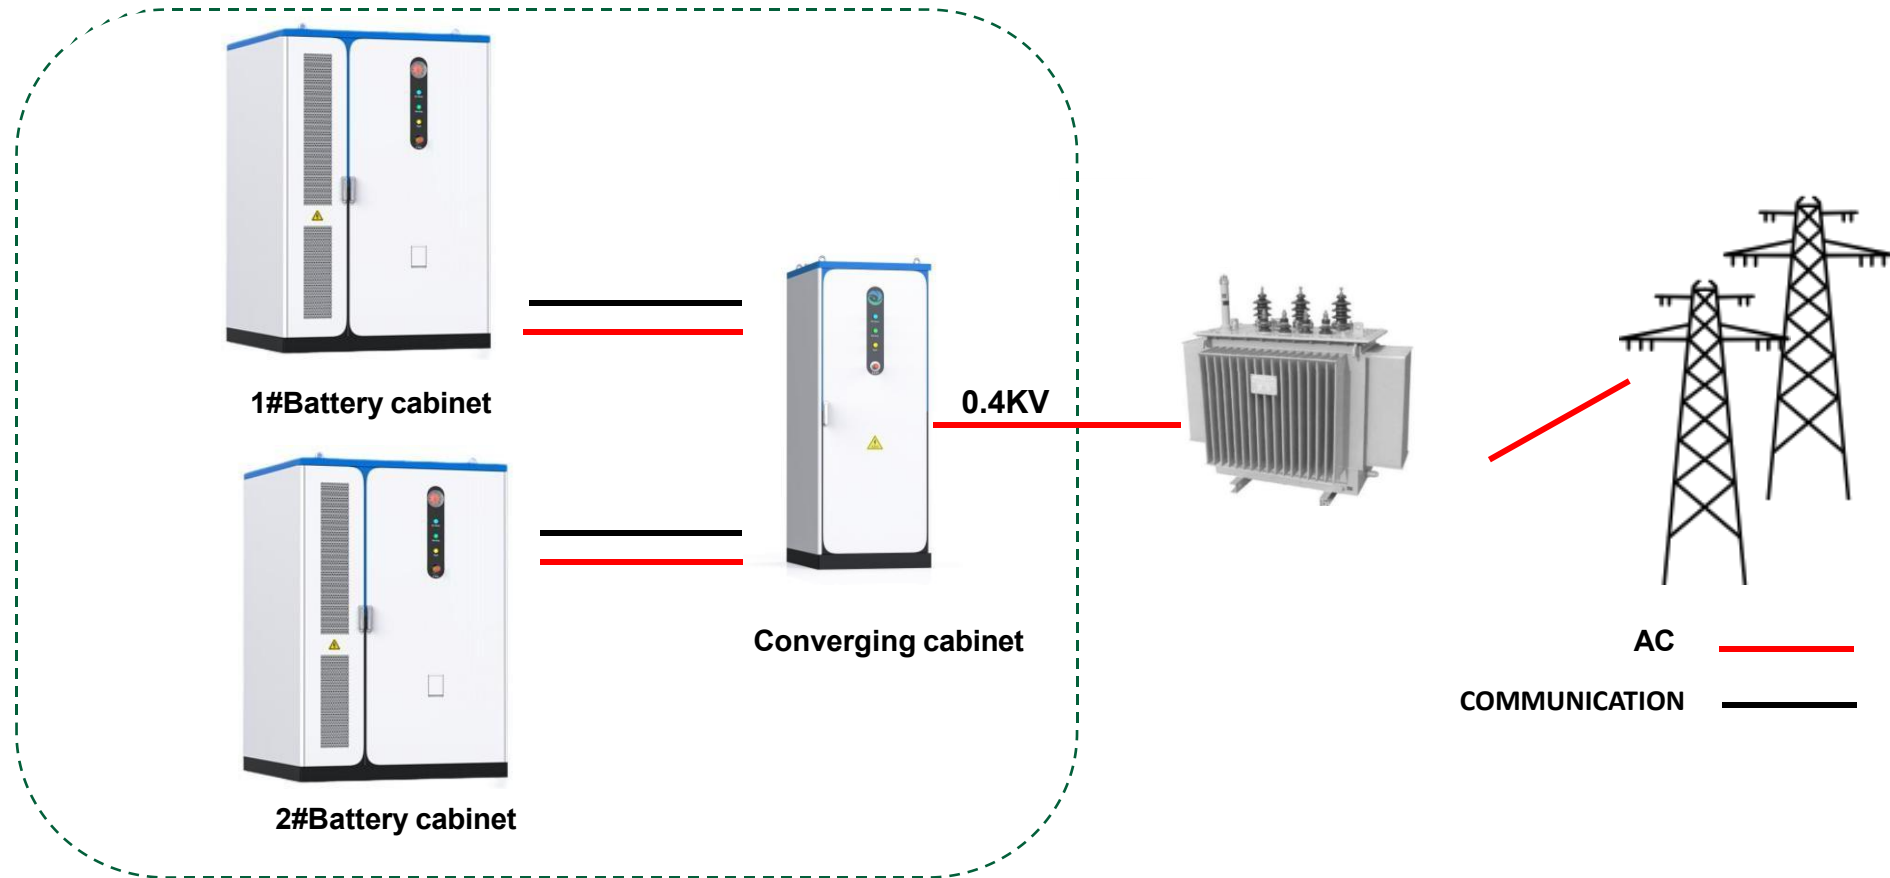

System Specification

No.	Performance index	Parameter
1	Configuration	2* (1P52S*5)
2	Qty. of Battery cabinet	2
3	Qty. of Converging cabinet	1
4	System capacity	522 KWh(2*261 KWh)
5	Rated AC power	250 KW(2*125 KW)
6	DC side voltage range	702~936V DC
7	Rated DC side voltage	832V DC
8	Rated AC side voltage	400V
9	Operating temperature	-30°C~+50°C(Derated use above 45°C)
10	Altitude	≤4000m (>2000m derating)
11	IP level	IP55

CONTACT US

ADDRESS: MOHANA RENEW CARE PRIVATE LIMITED

147a, SIDCO INDUSTRIAL ESTATE, MALUMICHAMPATTI (PO), COIMBATORE – 641 050

E-MAIL ID: marketing@mohanarenewcare.com

CALL US: +919043993857